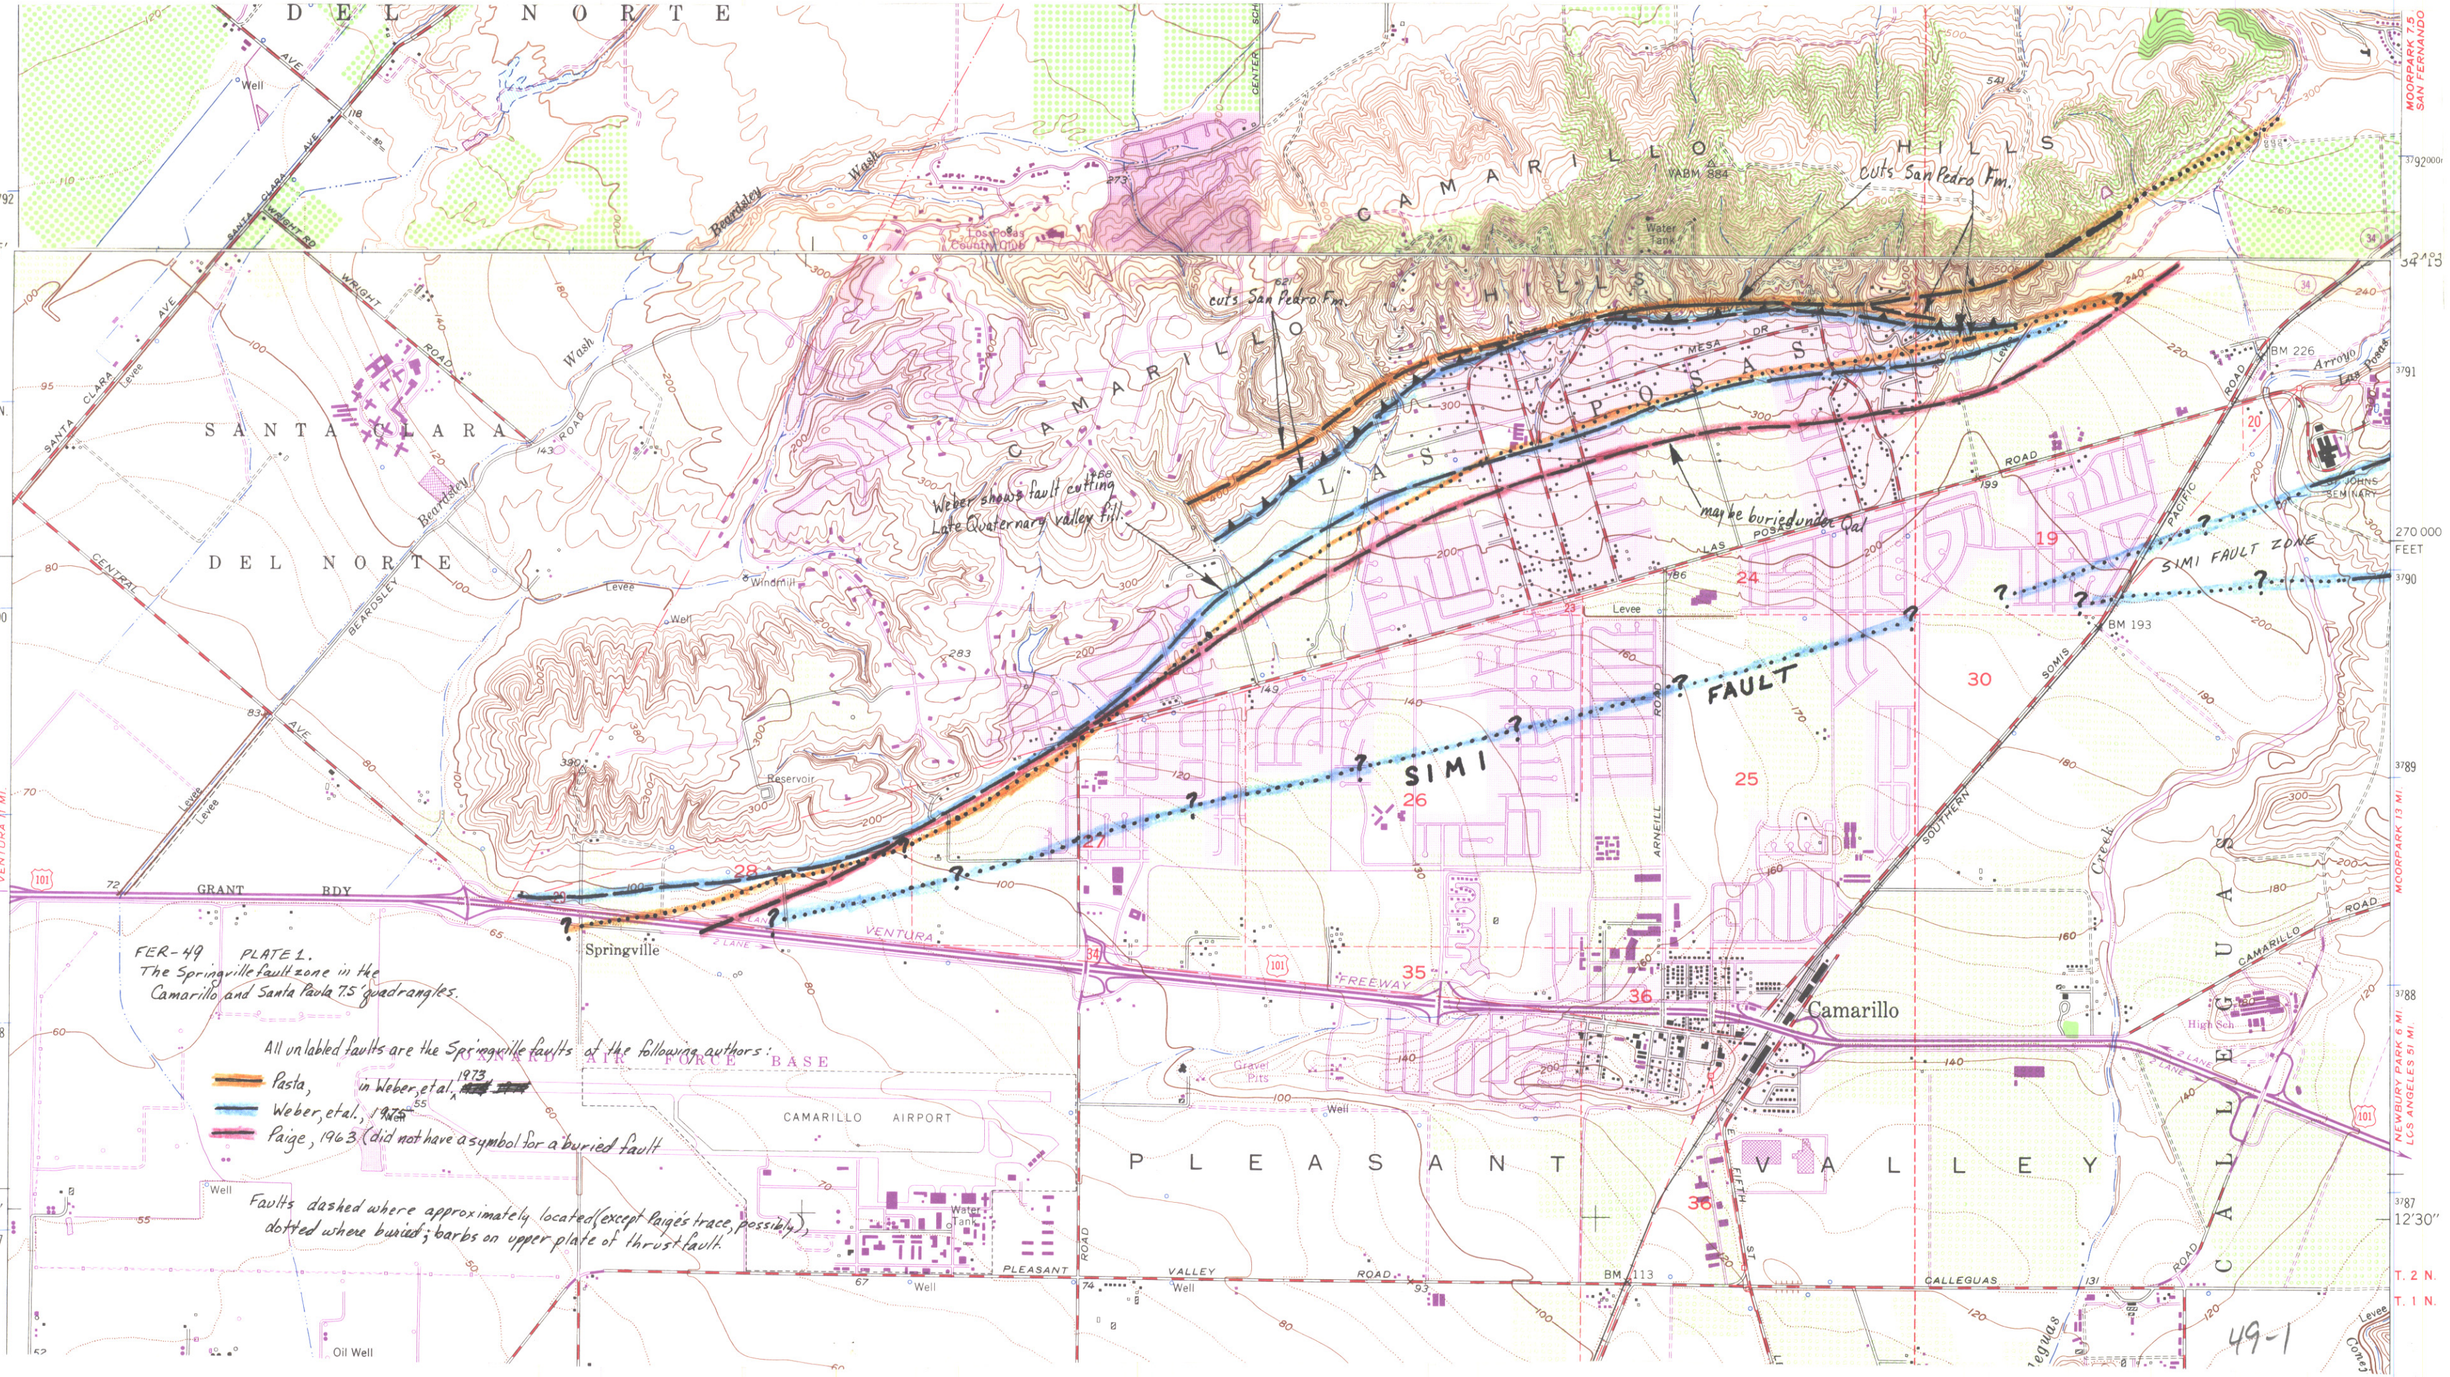

FER-49 PLATE 1.
The Springville fault zone in the Camarillo and Santa Paula 7.5' quadrangles.

All unlabled faults are the Springville faults of the following authors:

Pasta, in Weber, et al., 1973

Weber, et al., 1973

Paige, 1963 (did not have a symbol for a buried fault

Faults dashed where approximately located (except Paige's trace, possibly), dotted where buried; barbs on upper plate of thrust fault.